

14e  
West Wise Special Utility District  
P.O. Box 566  
Bridgeport, Texas 76426  
940-683-5507  
Fax 940-683-6607

July 28, 2016


Wise County Commissioner's Court  
Decatur, Texas

Commissioners,

West Wise SUD is respectfully requesting consideration for a permit to bore at 426 CR 3225 to supply water service to a customer.

Please see plans for additional details.

Sincerely,



James L. Ward

General Manager

West Wise Special Utility District  
P.O. Box 566  
Bridgeport, Texas 76426  
940-683-5507  
Fax 940-683-6607

September 16, 2016


Wise County Commissioner's Court  
Decatur, Texas

Commissioners,

West Wise SUD is respectfully requesting consideration for a permit to bore at 426 CR 3225 to supply water service to a customer.

Please see plans for additional details.

Sincerely,

A handwritten signature in black ink, appearing to read "James L. Ward". The signature is written in a cursive style with a large initial "J" and a long, sweeping underline.

James L. Ward

General Manager

**APPLICATION FOR PIPELINE UTILITY PERMIT**  
**DESIGNATING PLACEMENT OF UTILITY IN COUNTY RIGHT OF WAY**

TO: THE COUNTY ENGINEER OF WISE COUNTY, TEXAS

Comes now West Wise Special Utility District [company name], hereinafter referred to as "Company" a District [state] Corporation, with authority to transact business in Texas, acting by and through its duly authorized representative, and hereby petitions the County Engineer for the right to lay, construct, maintain, repair and/or operate equipment under, over, across and/or along certain County Roads as shown on drawings and diagrams attached hereto and said location described as follows:

Facility to Cross Road

Road Name & Block Number	Length of Crossing	TYPE OF CONSTRUCTION (CHECK ONE)			
		Bored	Jacked	Driven	Cased
426 CR 3225	44' total	X			X

Facility to Parallel County Road Within Right-Of-Way

Road Name and Block Number	From	To	Distance

CONSTRUCTION TYPE

1.125" Diameter .125" Wall Thickness  High Pressure Underground  Low Pressure Underground  
 Material Specification black poly waterline Pipeline (60 psi or greater operating pressure) Pipeline (60 psi operating pressure)  
 Minimum Yield Strength 1174  
 Maximum Operation Pressure 260

The location and description of the proposed installation and appurtenances must be fully shown on the attached detailed drawings.

The Company shall commence actual construction/work in good faith within 60 days from the date of said permit and shall complete said construction /work within 15 working days. (COMPANY MUST FILL IN). If such construction is not begun by the 60<sup>th</sup> day, Company will be required to apply for a new permit.

Company declares that prior to filing this application, it has ascertained the location of all existing utilities, both aerial and underground, and the filing of this application is prima facie evidence that the proposed installation will not conflict with any existing utility.

A copy of this permit shall be kept at the job site any time work is being performed.

It is expressly stipulated that this Permit is a license for permissive use only and that the placing of facilities upon public property pursuant to this permit shall not operate to create or vest any property right in said holder.

It is understood and agreed that the rights and privileges herein set out are granted only to the extent of the County's right, title and interest in the land to be entered upon and used by the holder and the holder will at all times assume risk of and indemnify, defend and save harmless Wise County from and against any and all loss, damages, cost or expense

arising in any manner on account of the exercise or attempted exercise by said holder of the aforesaid rights and privileges.

Any deviation from these specifications must be approved by Wise County Engineer's Office or its designated representative.

Approval of County Engineer's Office may take as long as two weeks after complete application is received.

Applicant agrees to comply with all rules of the County Commissioners and the County Engineer in construction of said installation attached hereto as **WISE COUNTY DESIGN STANDARDS AND SAFETY PRECAUTION REQUIREMENTS FOR WORK CONDUCTED IN WISE COUNTY RIGHTS OF WAY** and incorporated herein for reference.

*In the event Company fails to obtain a permit prior to the installation or does not install utilities in compliance with installation requirements set forth herein (i.e. depth, location, etc), Company assumes all financial responsibility for damages and/or destruction of lines, cables, etc. based upon its failure to comply with Wise County requirements.*


*Applicant agrees that if Wise County demonstrates a violation of the terms of this policy, Applicant stipulates that requisites for injunctive relief exist and that Wise County is entitled to relief enjoining any conduct by applicant which is contrary to the policies.*

*This permit is a revocable permit. Wise County reserves the right to revoke this permit at any time, in the sole discretion of Wise County, for interests of public health, safety or welfare, or for failure to repair any damages upon demand, or for any other reason deemed sufficient by Wise County.*

*In the event Company fails to comply with any or all of the requirements as set forth herein, the County may take such action as it deems appropriate to compel compliance. The County Engineer further retains the right to revoke this Permit by verbal notification to the Applicant/Company.*

*Failure to obtain this permit and/or notify the County Engineer's Office within 24 hours of beginning construction shall constitute grounds for job shutdown.*

By signing below, I certify that I am authorized to represent the Company listed below, and that the Company agrees to the conditions/provisions included in this permit.

West Wise Special Utility District  
 Company Name  
James L. Ward  
 By:   
 Signature  
General Manager  
 Title  
PO Box 566                      3412 FM 2952  
 Address  
Bridgeport                      Texas                      76426  
 City                                      State                                      Zip  
940-683-5507  
 Phone Number  
jlwwestwise@wccs.net  
 Email:

**PIPELINE UTILITY APPROVAL**

Wise County offers no objection to the proposed location of the utility in the County right of way as shown by accompanying drawings and notice dated \_\_\_\_\_ except as noted below:  
(Month/Day/Year)

EXCEPTIONS:


\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

Chad Davis  
Wise County Engineer  
Chad Davis, P.E.  
Signature  
9-21-16  
Title

West Wise Special Utility District P.O. Box 566 Rockport TX. 76426 940-683-5509

Any Thru 426 CR 3225 Rockport TX. 76426

New Service w/ 2" Bore Casing & 1" Poly Line - Single Meter Set

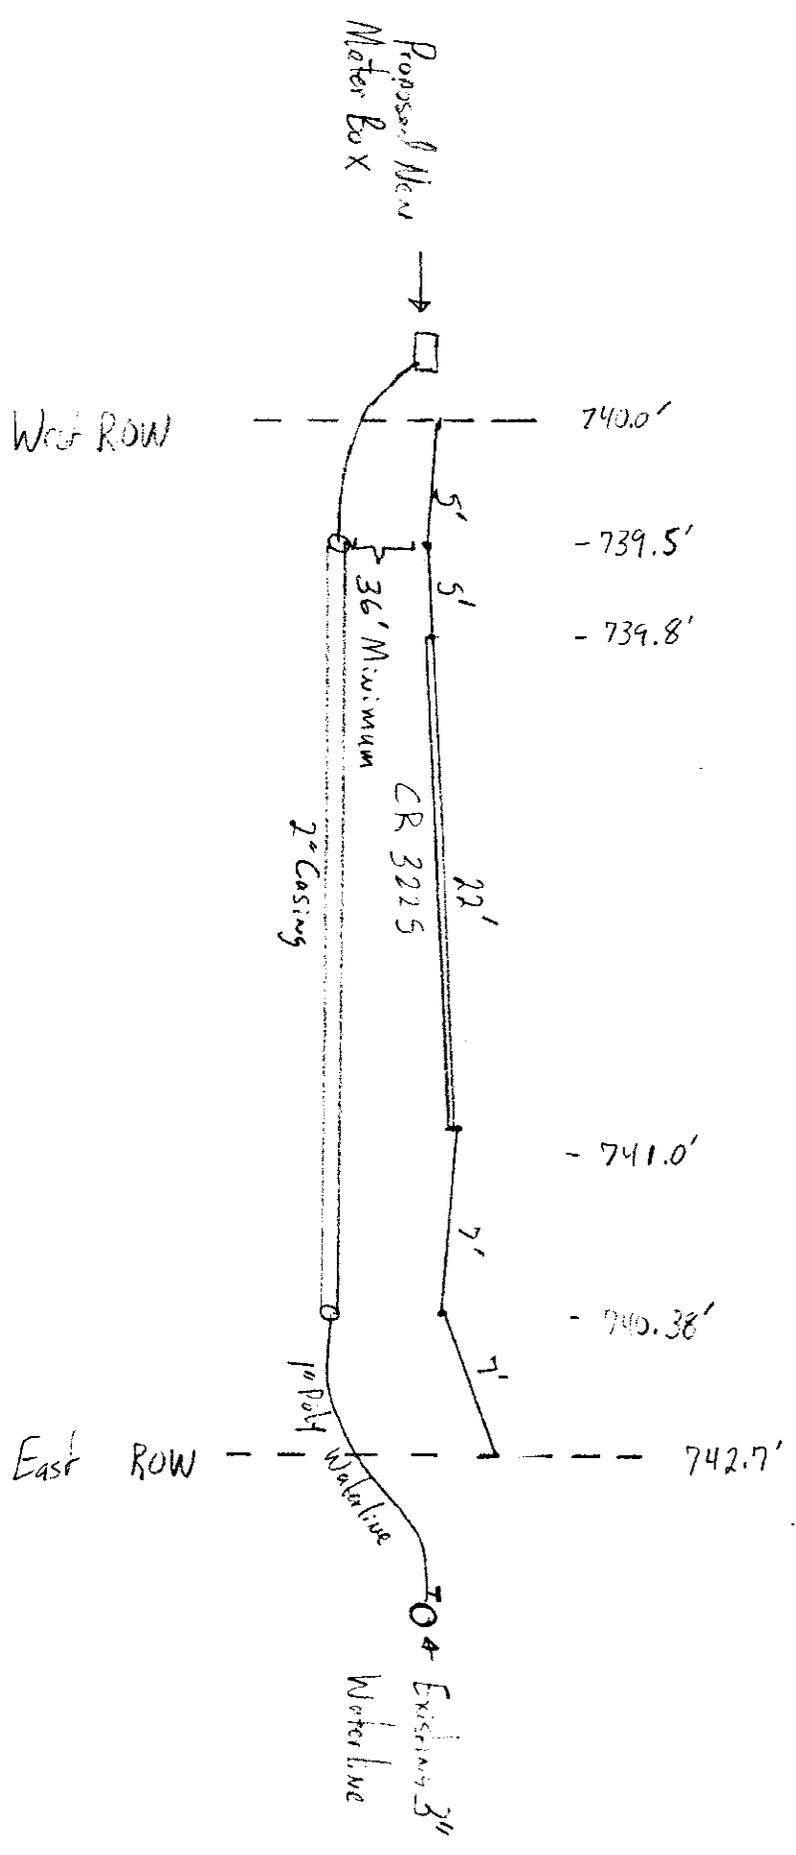

GPS: 33.196461, -97.712621

1sq. = 2'

ORDER GRANTING PERMIT AND RIGHT-OF WAY  
TO CONSTRUCT WATER PIPELINE

THE STATE OF TEXAS

COUNTY ROAD # 3225

THE COUNTY OF WISE

Now on this 26 day of September, 2016 at a meeting of the

Commissioners Court of Wise County, Texas, came on to be considered the application of

West Wise Special Utility District for a permit and right-of-way to lay water pipeline under the public roads of the County of Wise, State of Texas, and the Court having considered such application which was filed on the \_\_\_\_\_ day of \_\_\_\_\_, 2015 and is referred to and made a part hereof, and having determined that the permit an right-of-way for such water pipeline should be granted, it is accordingly ordered by the court:

1. That the County of Wise, State of Texas, does hereby grant the right, privilege and right-of-way to West Wise Special Utility District to lay, construct, maintain, and operate a water pipeline under the public roads in the County of Wise, State of Texas, as described:

Description and Location: 426 CR 3225

See plans for more detail.

2. That such waterline opening shall be bored, constructed and maintained as not to interfere with the use and occupancy of such public roads by the public. That such waterline shall be buried to the depth of minimum 36" (3' feet) below the lowest point of surface. Install visible marking of the crossing.
3. Said pipeline right-of-way shall be marked with pipeline marker signs at road

of-way fence lines.



Attest: Sherry Lemon  
Wise County Clerk

COUNTY COMMISSIONERS COURT

By: [Signature]  
County Judge, Wise County

Date: September 26, 2016

Approval to go to Court given by: Commissioner \_\_\_\_\_  
Precinct # \_\_\_\_\_  
Date: \_\_\_\_\_

BORE ONLY

14e  
West Wise Special Utility District  
P.O. Box 566  
Bridgeport, Texas 76426  
940-683-5507  
Fax 940-683-6607

September 13, 2016


Wise County Commissioner's Court  
Decatur, Texas

Commissioners,

West Wise SUD is respectfully requesting consideration for a permit to bore at 192 CR 1301 to supply water service to a customer.

Please see plans for additional details.

Sincerely,



James L. Ward

General Manager

**APPLICATION FOR PIPELINE UTILITY PERMIT**  
**DESIGNATING PLACEMENT OF UTILITY IN COUNTY RIGHT OF WAY**

TO: THE COUNTY ENGINEER OF WISE COUNTY, TEXAS

Comes now West Wise Special Utility District [company name], hereinafter referred to as "Company" a District [state] Corporation, with authority to transact business in Texas, acting by and through its duly authorized representative, and hereby petitions the County Engineer for the right to lay, construct, maintain, repair and/or operate equipment under, over, across and/or along certain County Roads as shown on drawings and diagrams attached hereto and said location described as follows:

Facility to Cross Road

Road Name & Block Number	Length of Crossing	TYPE OF CONSTRUCTION (CHECK ONE)			
		Bored	Jacked	Driven	Cased
192 CR 1301	44' total	X			X

Facility to Parallel County Road Within Right-Of-Way

Road Name and Block Number	From	To	Distance

CONSTRUCTION TYPE

1.125" Diameter .125" Wall Thickness  High Pressure Underground  Low Pressure Underground

Material Specification black poly waterline Pipeline (60 psi or greater operating pressure) Pipeline (60 psi operating pressure)  
 Minimum Yield Strength 1174  
 Maximum Operation Pressure 260

The location and description of the proposed installation and appurtenances must be fully shown on the attached detailed drawings.

The Company shall commence actual construction/work in good faith within 60 days from the date of said permit and shall complete said construction /work within 15 working days. (COMPANY MUST FILL IN). If such construction is not begun by the 60<sup>th</sup> day, Company will be required to apply for a new permit.

Company declares that prior to filing this application, it has ascertained the location of all existing utilities, both aerial and underground, and the filing of this application is prima facie evidence that the proposed installation will not conflict with any existing utility.

A copy of this permit shall be kept at the job site any time work is being performed.

It is expressly stipulated that this Permit is a license for permissive use only and that the placing of facilities upon public property pursuant to this permit shall not operate to create or vest any property right in said holder.

It is understood and agreed that the rights and privileges herein set out are granted only to the extent of the County's right, title and interest in the land to be entered upon and used by the holder and the holder will at all times assume risk of and indemnify, defend and save harmless Wise County from and against any and all loss, damages, cost or expense

arising in any manner on account of the exercise or attempted exercise by said holder of the aforesaid rights and privileges.

Any deviation from these specifications must be approved by Wise County Engineer's Office or its designated representative.

Approval of County Engineer's Office may take as long as two weeks after complete application is received.

Applicant agrees to comply with all rules of the County Commissioners and the County Engineer in construction of said installation attached hereto as **WISE COUNTY DESIGN STANDARDS AND SAFETY PRECAUTION REQUIREMENTS FOR WORK CONDUCTED IN WISE COUNTY RIGHTS OF WAY** and incorporated herein for reference.

*In the event Company fails to obtain a permit prior to the installation or does not install utilities in compliance with installation requirements set forth herein (i.e. depth, location, etc), Company assumes all financial responsibility for damages and/or destruction of lines, cables, etc. based upon its failure to comply with Wise County requirements.*


*Applicant agrees that if Wise County demonstrates a violation of the terms of this policy, Applicant stipulates that requisites for injunctive relief exist and that Wise County is entitled to relief enjoining any conduct by applicant which is contrary to the policies.*

*This permit is a revocable permit. Wise County reserves the right to revoke this permit at any time, in the sole discretion of Wise County, for interests of public health, safety or welfare, or for failure to repair any damages upon demand, or for any other reason deemed sufficient by Wise County.*

*In the event Company fails to comply with any or all of the requirements as set forth herein, the County may take such action as it deems appropriate to compel compliance. The County Engineer further retains the right to revoke this Permit by verbal notification to the Applicant/Company.*

*Failure to obtain this permit and/or notify the County Engineer's Office within 24 hours of beginning construction shall constitute grounds for job shutdown.*

By signing below, I certify that I am authorized to represent the Company listed below, and that the Company agrees to the conditions/provisions included in this permit.

West Wise Special Utility District  
Company Name  
James L. Ward  
By:   
Signature  
General Manager  
Title  
PO Box 566                      3412 FM 2952  
Address  
Bridgeport                      Texas                      76426  
City                                      State                                      Zip  
940-683-5507  
Phone Number  
jlwwestwise@wccs.net  
Email:

**PIPELINE UTILITY APPROVAL**

Wise County offers no objection to the proposed location of the utility in the County right of way as shown by accompanying drawings and notice dated \_\_\_\_\_ except as noted below:  
(Month/Day/Year)

EXCEPTIONS:

---

---

---


Chad Davis  
Wise County Engineer  
Chad Davis, P.E.  
Signature  
9-21-16  
Title

West Wisc SUD P.O. Box 566 Bridgeport, TX. 76426 Contact: James Ward

Customer Requesting Service: Tres Painter 192 CR 1301 Bridgeport, TX. 76426 817-805-0218

Tap Existing 2" WWSUD Water Line / 2" Bore / 2" x 1" Tap / 1" Poly Service Line / 3/4" Meter Set

GPS: 33.230833 / -97.727485

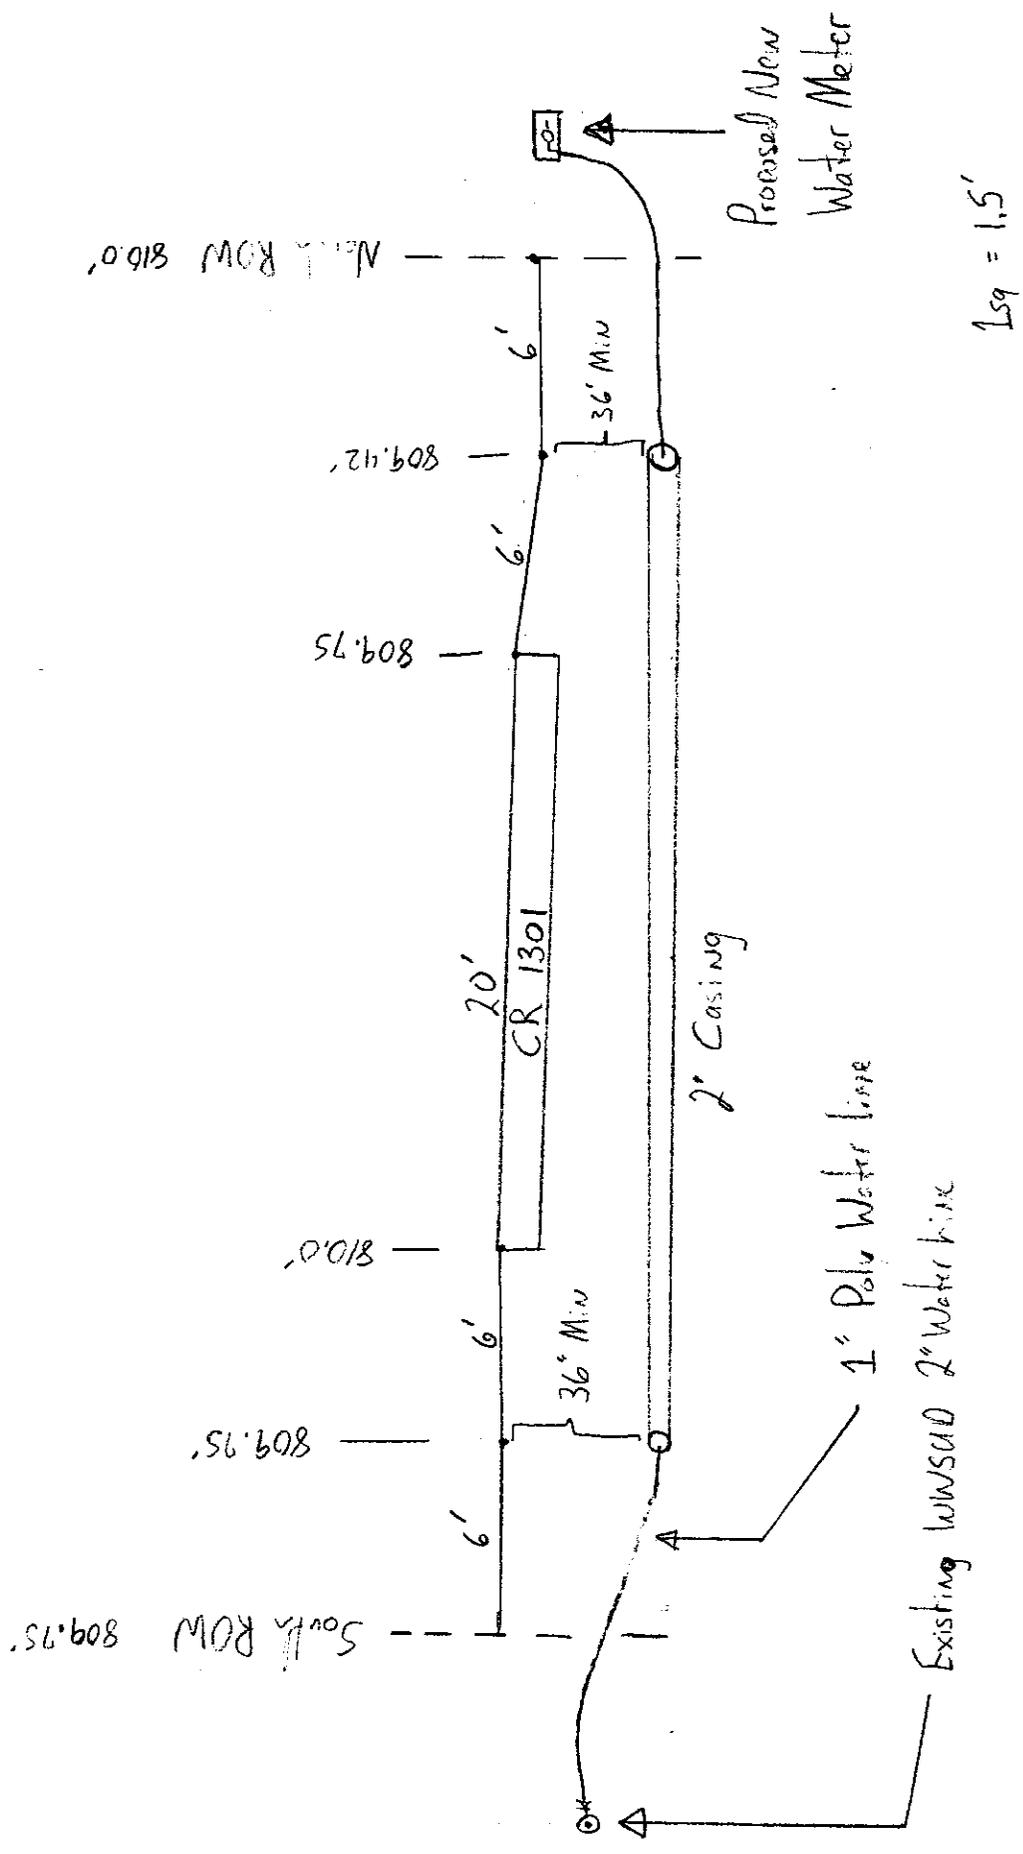


Google Maps

New House

Tres Painter

192 CR 1301 - Bridgeport

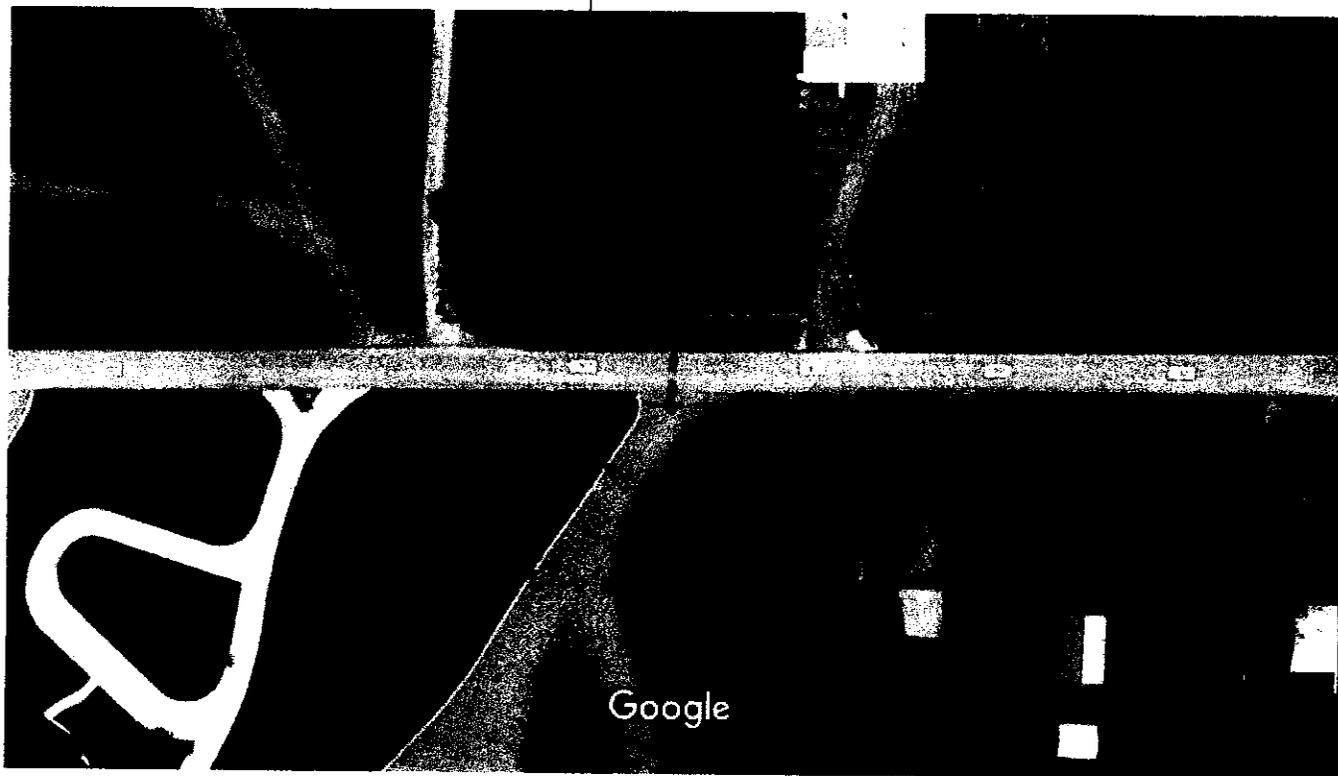

Imagery ©2016 Google, Map data ©2016 Google 50 ft

- - - - - Existing 2" Waterline
- - - - - Telephone Cable
- - - - - 2" Bore 1 1/2" Poly / Meter Set / 2' x 1" Top

**ORDER GRANTING PERMIT AND RIGHT-OF WAY  
TO CONSTRUCT WATER PIPELINE**

THE STATE OF TEXAS

COUNTY ROAD # 1301

THE COUNTY OF WISE

Now on this 26 day of September, 2016 at a meeting of the

Commissioners Court of Wise County, Texas, came on to be considered the application of

West Wise Special Utility District for a permit and right-of-way to lay water pipeline under the public roads of the County of Wise, State of Texas, and the Court having considered such application which was filed on the \_\_\_\_\_ day of \_\_\_\_\_, 2016 and is referred to and made a part hereof, and having determined that the permit an right-of-way for such water pipeline should be granted, it is accordingly ordered by the court:


1. That the County of Wise, State of Texas, does hereby grant the right, privilege and right-of-way to West Wise Special Utility District to lay, construct, maintain, and operate a water pipeline under the public roads in the County of Wise, State of Texas, as described:

Description and Location: 192 CR 1301

See plans for more detail.

2. That such waterline opening shall be bored, constructed and maintained as not to interfere with the use and occupancy of such public roads by the public. That such waterline shall be buried to the depth of minimum 36" (3' feet) below the lowest point of surface. Install visible marking of the crossing.

3. Said pipeline right-of-way shall be marked with pipeline marker signs at road right-of way fence lines.

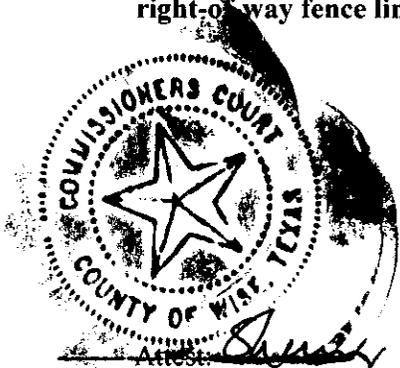

Attest: Jessy Lemon  
Wise County Clerk

COUNTY COMMISSIONERS COURT

By: [Signature]  
County Judge, Wise County

Date: September 26, 2014

Approval to go to Court given by:

Commissioner \_\_\_\_\_  
Precinct # \_\_\_\_\_  
Date: \_\_\_\_\_

**BORE ONLY**